
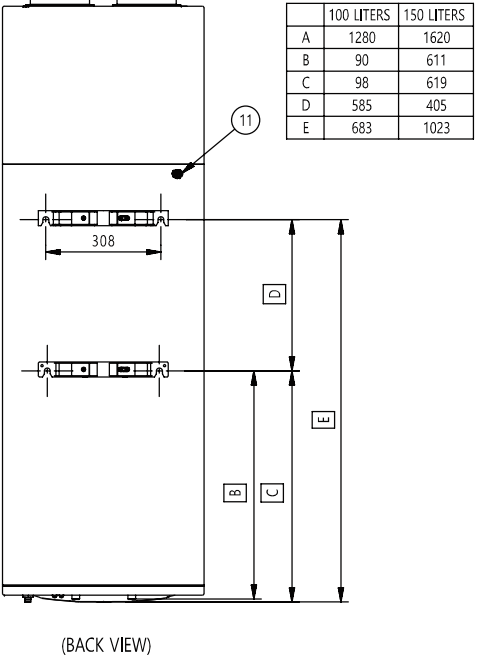
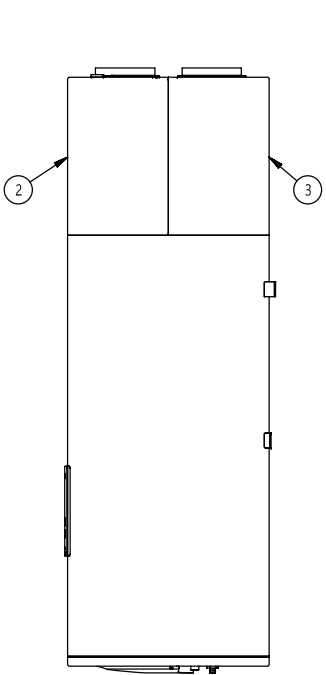
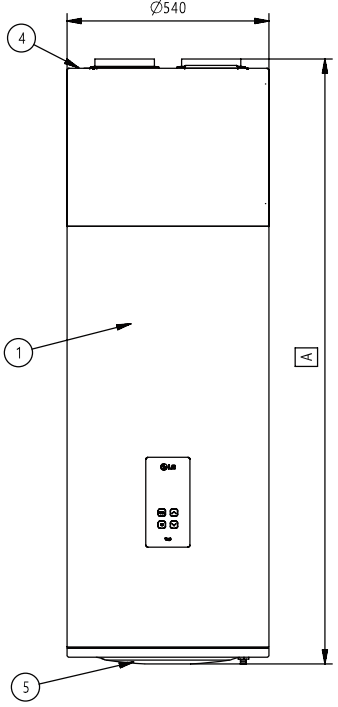
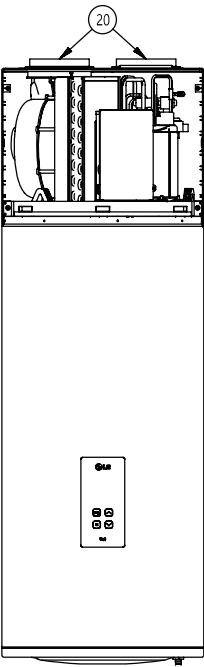
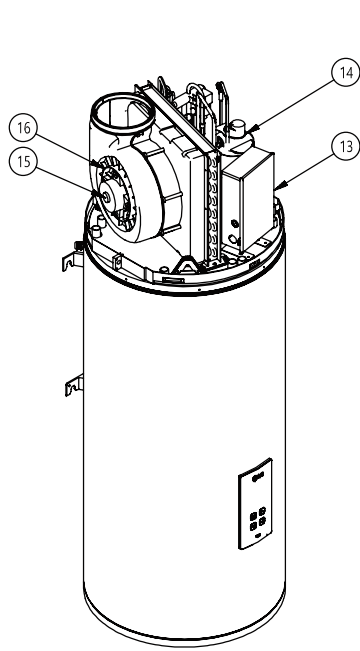


[Unit: mm]

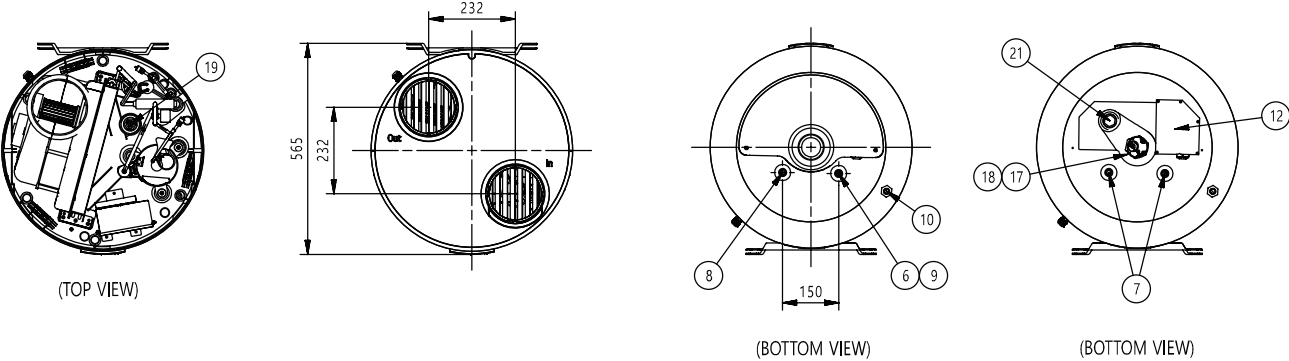

Symbols

- ➞ View Direction
- Datum line
- Refrigerant/Drain Piping Direction

Note

- Unit should be installed in compliance with the installation manual in the product box.
- Unit should be grounded in accordance with the local regulations or applicable national codes.
- All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.

			11	Power Cable	1.5 x 3
21	Anode Rod	Φ21.3 200	10	Condensate Drain	15 mm
20	Duct Connector	160Φ Duct Available	9	Inlet Pipe	Water In, G 1/2
19	ICCP	Ti	8	Outlet Pipe	Water Out, G 1/2
18	Heater	1EA, 1200W, 230V	7	Dielectric Union(Accessories)	2EA, Water In & Out
17	ECO	Emergency Cut Off (83℃)	6	P Valve(Accessories)	0.75MPa Open
16	Fan Propeller	Centrifugal Fan	5	Bottom Cover	-
15	Motor	15W	4	Top Cover	-
14	Compressor	WHP00950PSV	3	Rear Panel	-
13	C/box Case	-	2	Front Panel	-
12	Connecting Box Cover	For SG Signal	1	Water Tank	100L / 150L
No.	Part Name	Description	No.	Part Name	Description